

# Anguilla Electricity Company Limited



## REQUEST FOR QUOTATIONS

FOR

The Supply of Concrete Anchor Blocks

Procurement # T&D005

Issue Date: 14/05/2024

## **1.0 INTRODUCTION**

The *Anguilla Electricity Company Limited* is inviting Quotations for the provision of concrete anchor blocks in accordance with the enclosed documents. The contractor will be responsible for the construction and supply of one hundred (100) concrete anchor blocks as specified within this request for quotations.

## **2.0 SPECIFICATIONS**

The concrete anchor blocks should be 18" diagonal, have a concrete strength of 3000 PSI and be built to specification as shown in the attached document.

Only bidders who submit the following documents will be eligible for award of contract:

- i) a copy of a valid Business Licence in the relevant field;
- ii) a valid copy of a Tax Clearance Certificate from IRD

## **3.0 SCOPE OF WORKS**

You are required to provide the following deliverables:-

1. *One hundred (100) 18" Diagonal Concrete Anchor (Stay) Blocks as specified in the attachment.*

## **4.0 LANGUAGE AND CURRENCY**

Quotation must be submitted in English and all amounts must be quoted in EC Dollars (XCD\$). The currency converter if bid amount is payable in USD is \$2.6882.

## **5.0 WORK TO BE COMPLETED**

The services/works described above must be completed by 21<sup>st</sup> June 2024.

## **6.0 CLOSING DATE**

Quotations are to reach the Procurement Committee via sealed envelopes no later than 12:00 noon on *Tuesday 28<sup>th</sup> May, 2024.*

## **7.0 OPENING DATE**

Bids will be opened by ANGLEC procurement committee at 2:00pm on Tuesday 28<sup>th</sup> May, 2024 at ANGLEC *Admin Building.*



## 8.0 SUBMISSIONS

Bid should be submitted in a sealed envelope, labelled 'CONFIDENTIAL', and addressed as follows:-

**PROCUREMENT COMMITTEE**  
**Anguilla Electricity Company Limited**  
**Administration Building, Mahogany Tree Road**  
**THE VALLEY AI-2640**  
**ANGUILLA B.W.I.**

**Quote For: The Supply of Concrete Anchor Block**

## 9.0 AWARD

The *Anguilla Electricity Company Limited* will not be bound to accept the lowest or any quotation submitted. The *Anguilla Electricity Company Limited* may cancel this Request for Quotation at any time without liability.

The contract will be awarded to the lowest responsive evaluated bidder.

Bidders will be advised in writing of the status of their bid upon decision of award.

## 10.0 QUESTIONS/CLARIFICATION REQUESTS

All questions/clarification requests pertaining to this RFQ can be directed in writing to the address below on or before ***Tuesday, 21<sup>st</sup> May 2024 & 12:00 noon:-***

PROCUREMENT COMMITTEE  
CHAIRPERSON PROCUREMENT COMMITTEE

*The Anguilla Electricity Company Limited*  
Administration Building, Mahogany Tree Road

THE VALLEY AI-2640  
ANGUILLA B.W.I.

Fax: 264-497-5440

Email: [procurement@anglec.com](mailto:procurement@anglec.com)


## 11.0 PRICE BREAKDOWN

Persons are required to complete the attached Quote Form template to itemise material and services being provided. All costs, including delivery costs (if applicable), must be clearly stated within bid.




# 18" DIA CONCRETE STAY BLOCK

3/4"Ø HOLE THROUGH CENTER OF BLOCK

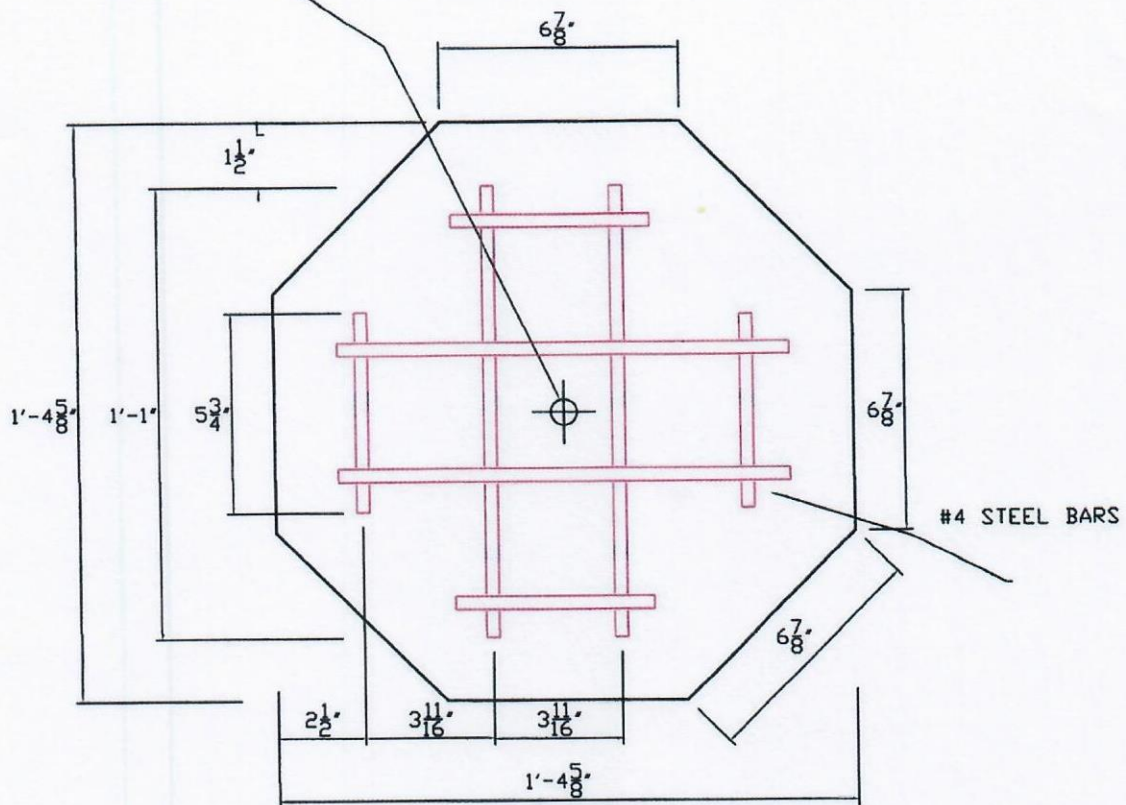

3/4"Ø HOLE THROUGH CENTER OF BLOCK

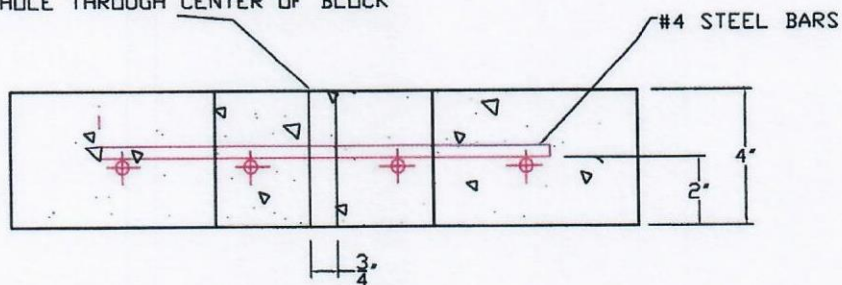

#4 BARS 13" LONG EQUALLY SPACED @ 3-11/16" ON CENTERS BOTH WAYS.  
 CONCRETE COVER ON ENDS OF BARS TO BE 1-1/2"  
 BARS TO BE EQUALLY SPACED FROM TOP AND BOTTOM FROM SLAB  
 GRAVEL USED FOR MIXING CONCRETE SHALL BE 3/8" TO 3/4" MAXIMUM.  
 CONCRETE SHALL BE 3000 PSI STRENGTH.

ANGUILLA ELECTRICITY COMPANY, LTD.

18" DIA REINFORCED OCTAGON CONCRETE STAY BLOCK


DATE: MAY 29, 2013

DRAWN BY: THC


DRAWN NO: TA/04/02



3/4"Ø HOLE THROUGH CENTER OF BLOCK

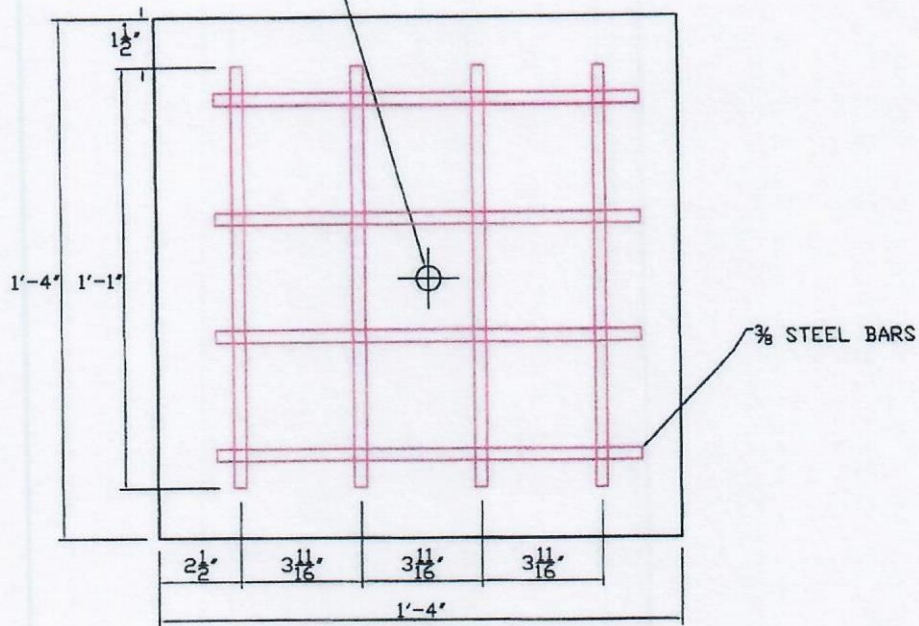

3/4"Ø HOLE THROUGH CENTER OF BLOCK

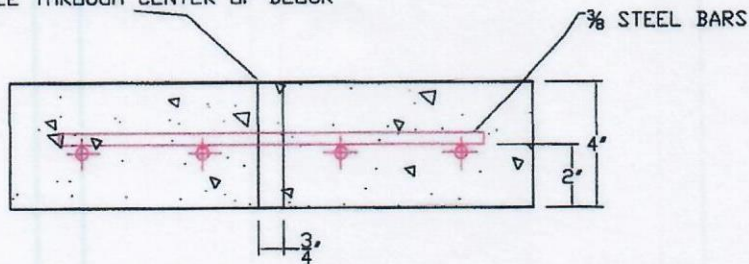

3/8" BARS 13" LONG EQUALLY SPACED @ 3-11/16" ON CENTERS BOTH WAYS.  
 CONCRETE COVER ON ENDS OF BARS TO BE 1-1/2"  
 BARS TO BE EQUALLY SPACED FROM TOP AND BOTTOM FROM SLAB  
 GRAVEL USED FOR MIXING CONCRETE SHALL BE 3/8" TO 3/4" MAXIMUM.  
 CONCRETE SHALL BE 3000 PSI STRENGTH.

ANGUILLA ELECTRICITY COMPANY, LTD.		
REINFORCED CONCRETE STAY BLOCK		
DATE: NOV 6, 2004	DRAWN BY: THC	DRAWN NO: TA/04/01